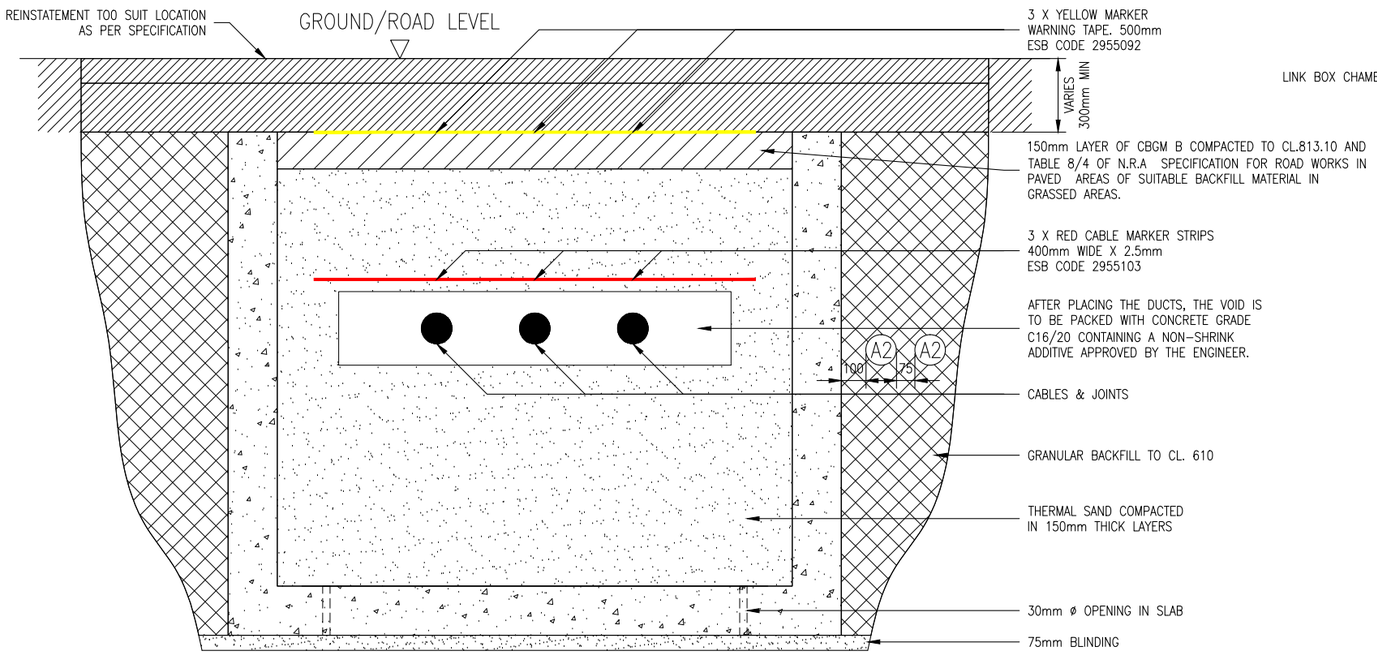

A - SECTION A – PERMANENT REINSTATEMENT
SCALE 1:50

A2 = 125mm ø HDPE DUCT (COMMS)

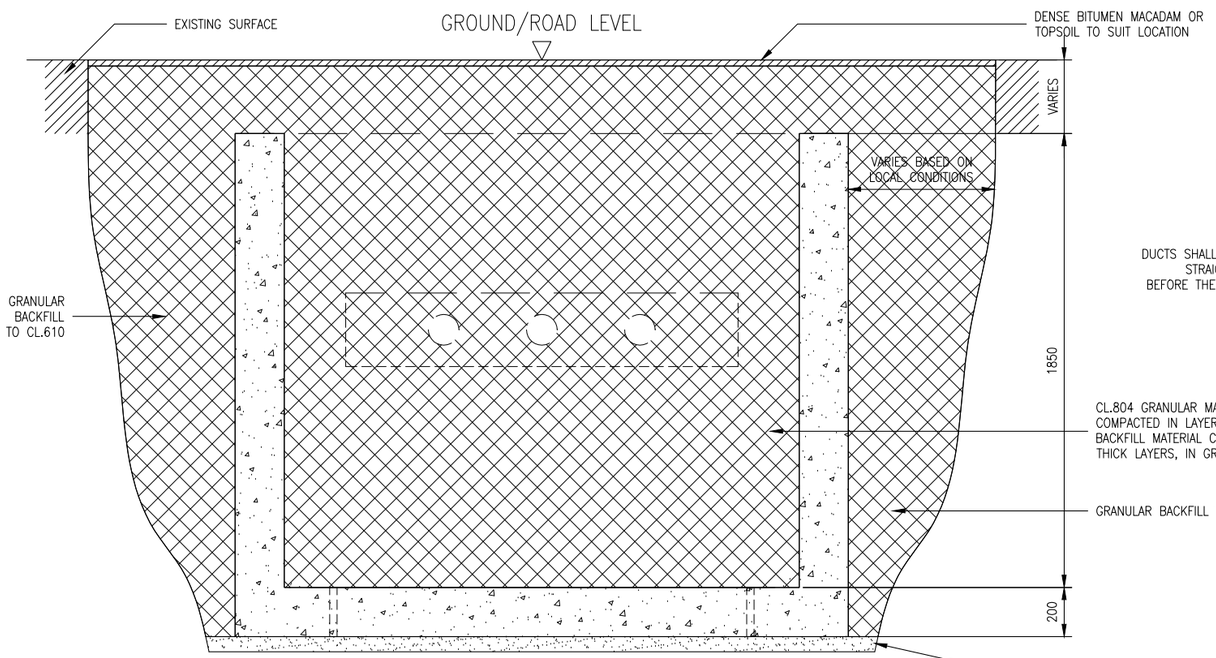

A - SECTION A – TEMPORARY REINSTATEMENT
SCALE 1:50

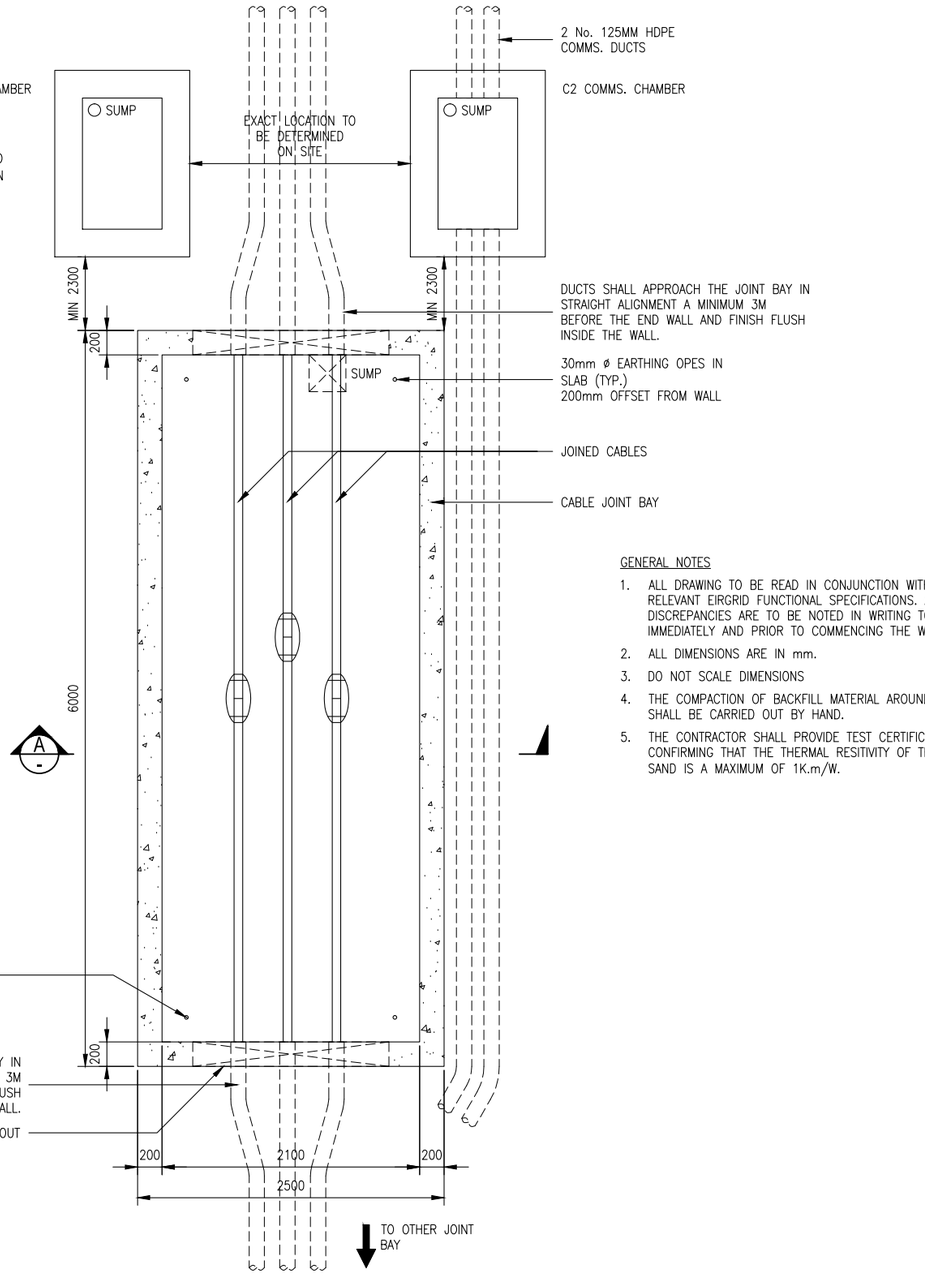

TYPICAL PLAN OF JOINT BAY IN ROAD
SCALE 1:50

GENERAL NOTES

1. ALL DRAWING TO BE READ IN CONJUNCTION WITH THE RELEVANT EIRGRID FUNCTIONAL SPECIFICATIONS. ANY DISCREPANCIES ARE TO BE NOTED IN WRITING TO EIRGRID IMMEDIATELY AND PRIOR TO COMMENCING THE WORK.
2. ALL DIMENSIONS ARE IN mm.
3. DO NOT SCALE DIMENSIONS
4. THE COMPACTION OF BACKFILL MATERIAL AROUND CABLES SHALL BE CARRIED OUT BY HAND.
5. THE CONTRACTOR SHALL PROVIDE TEST CERTIFICATES CONFIRMING THAT THE THERMAL RESITIVITY OF THE THERMAL SAND IS A MAXIMUM OF 1K.m/W.

REV	DESC	DRAWN	CHECKED	APPROVED	DATE
00	FIRST ISSUE	DA	DG	CF	09/03/2020

EirGrid plc
The Oval, 160 Shelbourne Road,
Ballsbridge, Dublin 4, Ireland
Telephone: +353 1 677 1700
Fax: +353 1 661 5375
Email: info@eirgrid.com
Web: www.eirgrid.com

COPYRIGHT © EirGrid plc
All rights reserved. No part of this work may be modified or reproduced or copied in any form or by any means – graphic, electronic or mechanical, including photocopying, recording, taping or information and retrieval system, or used for any purpose other than its designated purpose, without the written permission of EirGrid plc

PROJECT
STANDARD 110kV CABLE DRAWINGS

DRAWING TITLE
JOINT BAY REINSTATEMENT

No of Shts	SIZE	SCALE
8	A3	N/A

DRAWING NUMBER	SHEET	REV
XDC-CBL-STND-H-012	007	00